


Grup combustie  
OHA 200,180  
sau echivalent



**CABLU MYYM 5x4 mmp**  
**L = 50 ml**  
**montat pe pat de cablu PVC 25x25 mm**

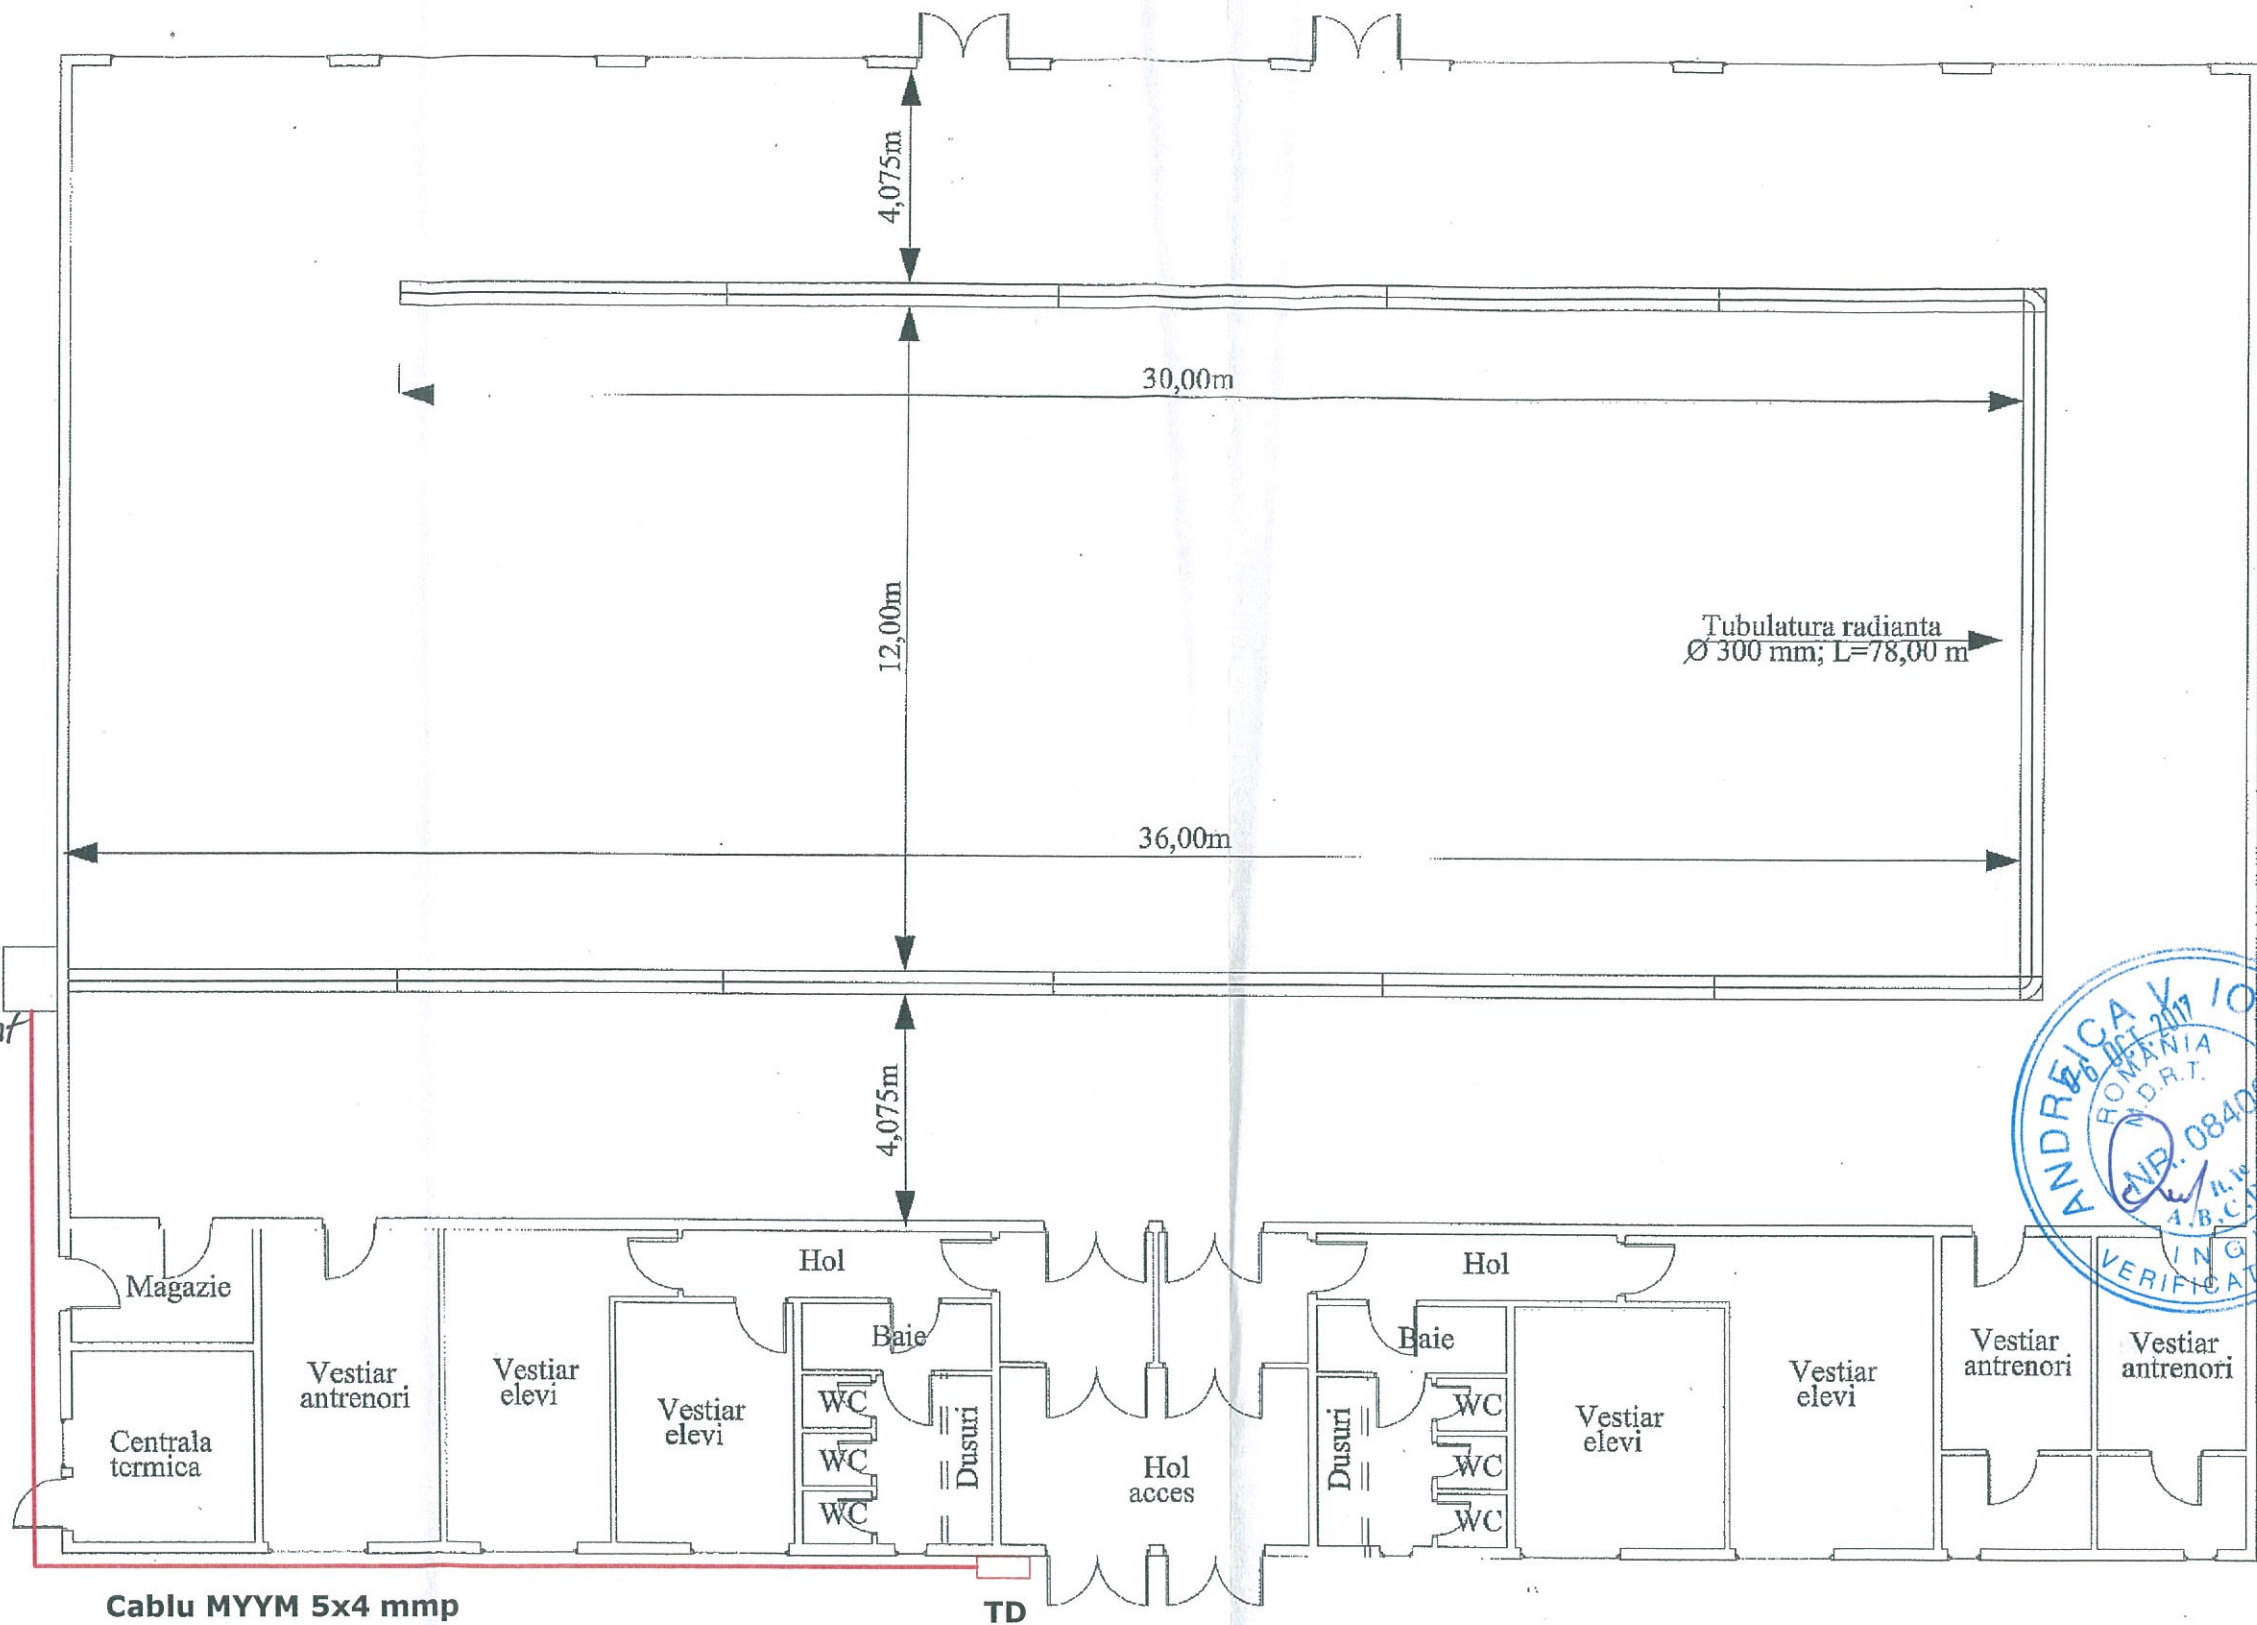

Verificator / Expert		Nume	Semnatura	Cerinta	Referat / Expertiza	Data
SC ELECTROCONSTRUCTIA ELCO BISTRITA SA <b>Elco Bistrita</b> electroconstructia		Beneficiar: LICEUL TEHNOLOGIC AGRICOL BISTRITA			Nr. Proiect:	Faza SS
Sef Proiect	Ing. Tătar Alexandra	Scara:	<b>ALIMENTARE CU ENERGIE ELECTRICA GRUP COMBUSTIE LA HALA DE SPORT - LICEUL TEHNOLOGIC AGRICOL BISTRITA</b>			
Proiectant	Ing. Deac Marius			Denumire plansa:	Plan de situatie	Plan: 1
Verificat	Ing. Tătar Alexandra					
Desenat	Ing. Deac Marius	Data:	05.2017			
Aprobat	Ec. Deac Virgil					